



# SERIES 'TM' MAGNETIC COUPLED PUMPS

## Polypropylene, PVDF, 316SS

OPERATION AND  
SERVICE GUIDE  
O-2801\_A  
10/18/2021

Refer to Bulletin: **P-513 (TM)**  
**P-516 (TM-SS)**

To obtain optimum performance from your SERFILCO pump please review these instructions carefully. Failure to follow these recommendations may result in severe pump damage and premature failure, along with voiding your factory warranty.

### INSTALLATION

NOTE: The vast majority of pumping problems occur as a result of poor suction conditions. This section in particular should be reviewed carefully.

1. Locate the pump as close to the liquid supply source as possible.
2. The pump inlet should be well below the supply tank liquid level to avoid vortexing.
3. The suction line should be rigid (vacuum service), and as straight and short as possible.
4. Long radius elbows are preferred and increased size is recommended.
5. The suction line should never be a smaller ID than the pump suction port.
6. The suction line should continuously decline to the pump to avoid air pockets.  
NOTE: Reducers on the suction should be of the eccentric type.
7. A motor starter is recommended to:
  - Prevent accidental re-start after a power failure
  - Provide a safe, moisture-proof switch enclosure
  - Protect the motor with a correctly sized overload
  - Withstand high starting current and prevent arcing & contact wear

### START-UP AND RUNNING

1. Check that the suction side valve is open and liquid supply is sufficient.  
NOTE: If pump is started before opening the valve it may become air-locked and run dry.
2. Bump start the motor to check that rotation is clockwise facing the pump (CCW facing motor fan).
3. Discharge valve should be partially closed and opened gradually after starting.

### ESSENTIAL RUNNING PRECAUTIONS

1. **DO NOT RUN DRY**  
Mag-drive pumps are cooled and lubricated with product.
2. Avoid pumping liquids containing abrasive particles. NOTE: SERFILCO pumps are suitable for filter feed of plating solutions containing small solids. Consult SERFILCO for guidance.
3. A 40-80 mesh suction strainer is recommended if solids are likely.
4. To reduce flow partially close the discharge valve (suction valve is always fully open).
5. If the fluid being pumped tends to crystallize, the pump should be flushed prior to extended shut down.

### OPERATING LIMITS

1. **FLOW:** Pumps may be operated at any point along the

related published performance curves of the particular impeller diameter being used. The minimum flow required is indicated by the end of the curve to the left, and maximum flow by the end of the curve to the right.

2. **OPERATING PRESSURE:** Non-metallic Pumps - 110 psi maximum internal pressure  
316SS Pumps - 275 psi maximum internal pressure
3. **TEMPERATURE:**  
Polypropylene Pumps - 160°F continuous, 180°F intermittent  
PVDF Pumps - 190°F continuous, 220°F intermittent  
316SS Pumps - 300°F continuous, 350°F intermittent

SERFILCO pumps are intended for use with liquids up to 45 cPs viscosity and 1.8 S.G. For services beyond these limits contact SERFILCO'S applications engineering department.

### MAINTENANCE

In General, SERFILCO pumps require no routine or regular maintenance. Depending on the nature of the process fluid, a periodic check of the impeller thrust and sleeve bearings is advised. Excessive wear may result in misalignment of the impeller magnet and if left unchecked, interference with the rear casing.

### DISASSEMBLY

1. Isolate the pump from the rest of the system by closing related valves.
2. Drain the pump and adjacent piping.
3. Remove pump case bolts.
4. Carefully separate pump head from the bracket and internal assembly.
5. Remove impeller-magnet assembly from shaft.
6. Examine thrust bearings, shaft, and sleeve bearings for excessive radial play.

### RE-ASSEMBLY

1. Replace worn components.
2. Insert shaft into rear casing. NOTE: Flat end of shaft mates to flat on rear washer.
3. Check that impeller mouth ring is in proper position.
4. Check that ceramic casing mouthring is pressed into proper position.
5. Place rear casing into adapter bracket and hand press into position.
6. Place bracket on bench with rear casing facing up
7. Carefully place impeller-magnet assembly into rear casing.
8. Place O-Ring into seat on face of rear casing.
9. Place pump case into position
10. Check position of discharge port in relation to adapter weep hole
11. Secure casing bolts. **DO NOT OVER TIGHTEN**
12. Set assembly on to motor flange (tap into place with rubber mallet if necessary).
13. Secure four motor adapter bolts. Again, do not over tighten.

# MAG-DRIVE PUMPS


## PUMP ASSEMBLY TO MOTOR

### DO NOT DISASSEMBLE PUMP END

1. Remove white cardboard packing from inside the pump/motor adapter housing.
2. Remove external magnet from pump assembly.  
Note: the external magnet is held in place with magnetic attraction to internal magnet so there will be some resistance.
3. Place external magnet onto motor shaft, locating magnet so set screws will tighten into motor key way (no key on magnet). Use rubber mallet if necessary.
4. Locate proper setting of magnet per "External Magnet Location" drawing.

5. Stand motor on end.
6. Holding it tightly (the magnets will attract during assembly) carefully place the entire assembly onto motor.
7. Locate housing bolt holes on adapter with tapped motor bolt holes and thread in screws by hand several threads. Be certain to place discharge in desired position. Typically this is facing up, but can also be mounted to either side.
8. Use rubber mallet to snug down motor adapter flush to motor. **DO NOT ATTEMPT TO SNUG TIGHT WITH BOLTS AS THIS COULD DISTORT THE PUMP MOTOR ADAPTER AND CAUSE MISALIGNMENT.**
9. Secure adapter bolts to motor. **DO NOT OVERTIGHTEN**  
The unit is now ready for installation. **DO NOT RUN DRY**

### 'TM' Series Polypro and PVDF External Magnet Location

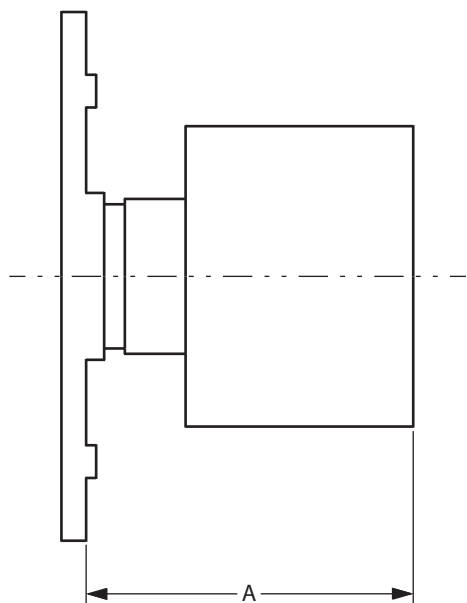

PUMP MODEL	MOTOR FRAME	HP	SHAFT Ø	"A" (INCHES)
TM6	56C	1/3 - 1	5/8	3.60
TM10	56C	3/4 - 2	5/8	4.18
TM15	56C / 145TC	1½ - 3	5/8 / 7/8	4.98
TM31	145TC	3	7/8	5.75
TM31	184TC	5	1½	5.75

### TM-SS SERIES 316SS External Magnet Location

PUMP TYPE	MOTOR FRAME	"A" (in)	
		fig 1	fig 2
TMSS6	NEMA 56C / 143-5TC	5.02	
TMSS10	NEMA 56C / 143-5TC NEMA 143TC - 145TC	5.10	
TMSS15	NEMA 143TC - 145TC NEMA 182TC - 184TC		4.77 5.43
TMSS30	NEMA 182TC - 184TC NEMA 213TC - 215TC		5.08 5.75

**316 STAINLESS STAINLESS STEEL**

MOTOR FLANGE

(MOTOR)

←A±0.02→ fig.1

MOTOR ADAPTER FLANGE

(MOTOR)

←A±0.02→ fig.2



# SERFILCO®

Chemical resistant pumps & filters engineered for industry

2900 MacArthur Blvd.  
Northbrook, IL. 60062-2005 U.S.A (800) 323-5431  
E-Mail: sales@serfilco.com (847) 509-2900  
Web: www.serfilco.com (847) 559-1141

© 2021 SERFILCO Ltd, All Rights Reserved.